


VALVE TEST REPORT


Date: 2019-6-7 11:5:54

NO.201967-1026


VALVE TYPE	BALL VALVE	TAG NO	DL002	PRESSURE RATING	CLASS 300			
SERIAL NO	093F1701014	END TYPE	FLANGE	DATE OF TEST	06/06/2019			
SIZE	2"	CUSTOMER	MUESTRA					
TEST MEDIUM	WATER	PROJECT	0-100	PROJECT	API 598			
TEST ITEM	Medium	Test Pressure(MPa)		Duration(sec)		Leakage(ml/min) (bubble/min)		Conclusion
		Standard	Test	Standard	Test	Standard	Test	
SHELL TEST	WATER	7.8	7.8	15	15	0	0	Qualified
LEFT SEAL TEST	WATER	5.7	5.8	15	15	0	0	Qualified
RIGHT SEAL TEST	WATER	5.7	5.7	15	15	0	0	Qualified
SHELL TEST	WATER	7.8	7.8	15	15	0	0	Qualified
LEFT SEAL TEST	WATER	5.7	6.0	15	15	0	0	Qualified
RIGHT SEAL TEST	WATER	5.7	5.8	15	15	0	0	Qualified

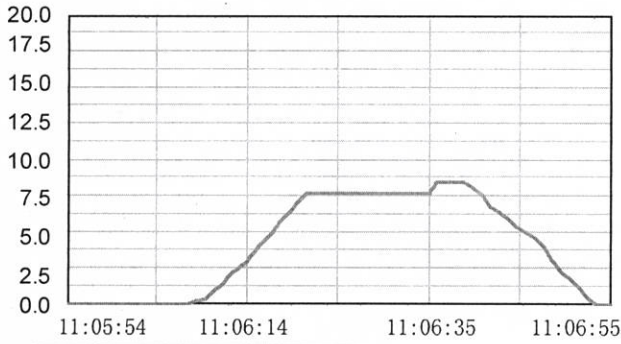


1 SHELL TEST

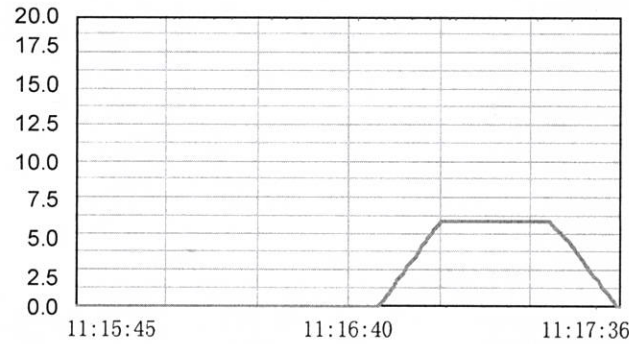


2 LEFT SEAL TEST

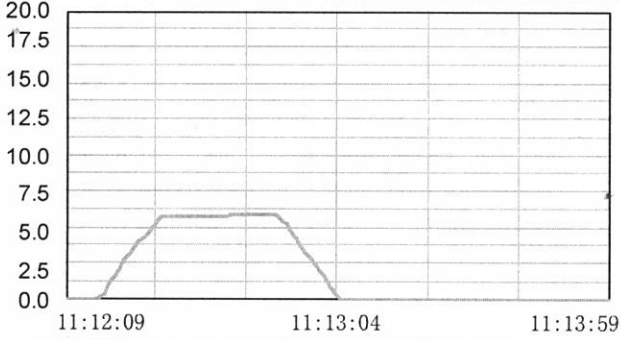


3 RIGHT SEAL TEST

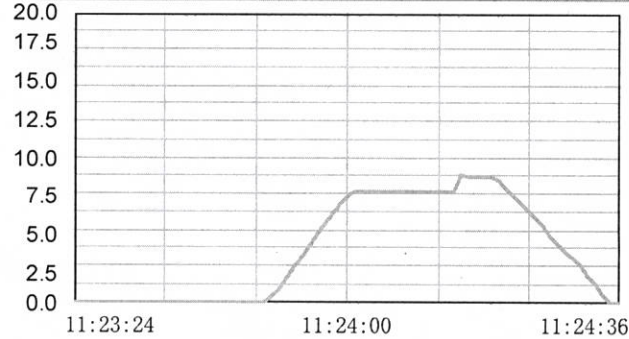

4 SHELL TEST

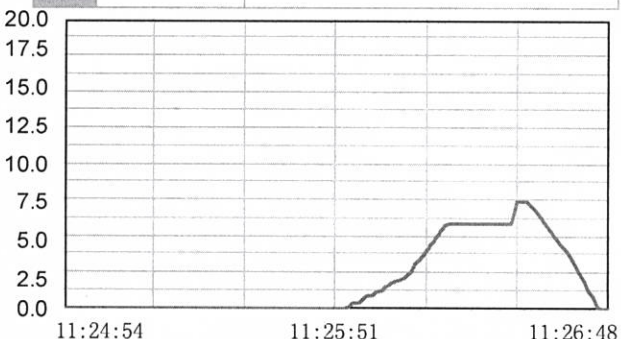

5 LEFT SEAL TEST

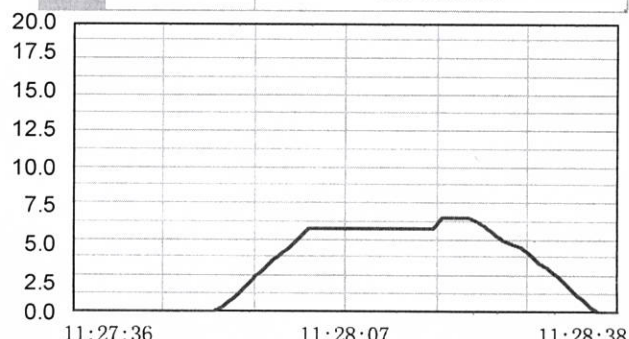

6 RIGHT SEAL TEST

#####

#####